


Fig 1

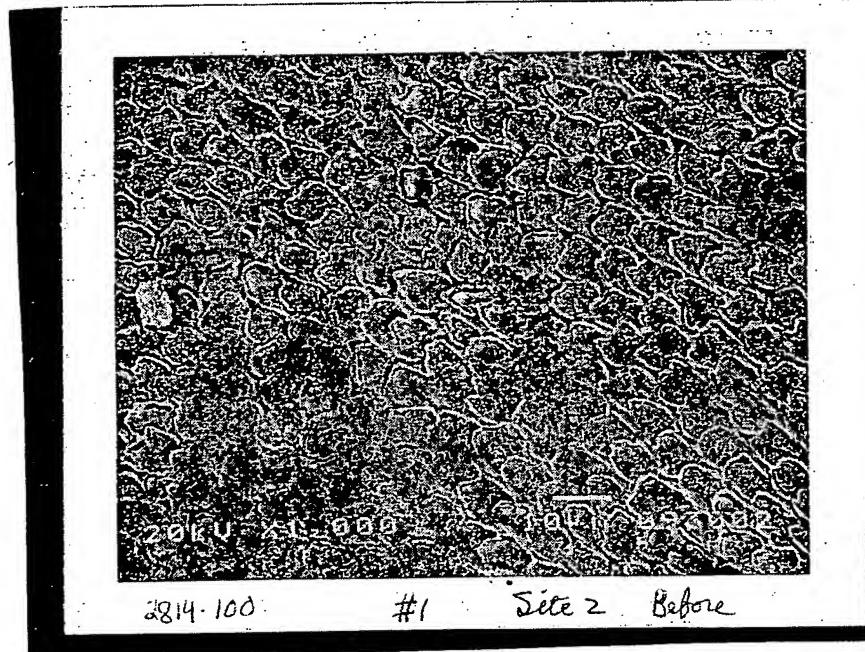


20KV 1.000

2814.100

#1

Site 2 Before

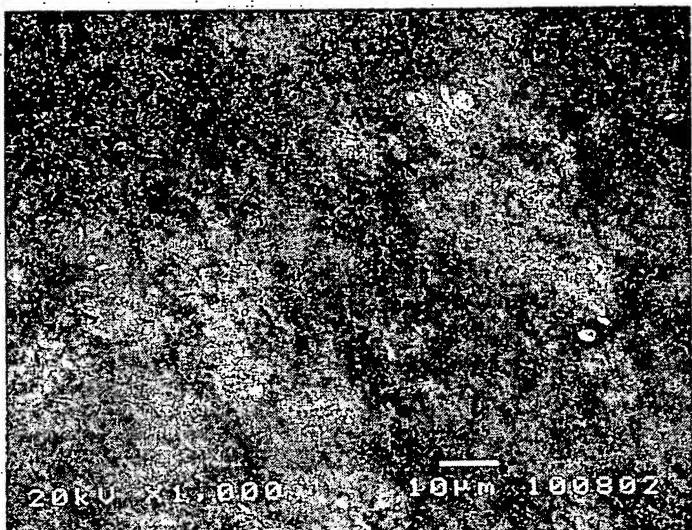

(Fig) 2

2814.100

#1 Sub 2 After